


Corrigendum-2

TENDER No.: AGL/0514/MANUAL TENDER/STATION PIPING/10-2025 Dated 05.12.2025

S. No.	BIDDER'S QUERY	AGL REPLY
1	GAD drawing required	Refer Drawing No.- DWG/AGL/HOOKUP/01 (Attached)
2	Isometric drawing required.	
3	Whether 3.1 or 3.2 Fitting/pipe/flanges etc certification required, plz clarify	3.2 Certification required
4	In BOQ fitting and other material quantity is not mentioned, only length is mentioned, requesting you to kindly provide the quantity.	Refer Drawing No.- DWG/AGL/HOOKUP/01 (Attached)

This Corrigendum-2 forms an integral part of the TENDER No.: AGL/0514/MANUAL TENDER/STATION PIPING/10-2025 Dated 05.12.2025 and a copy of the same is to be submitted along with the Bid.

STATION PIPING & HOOKUP WORK AT PITHAMPUR CGS

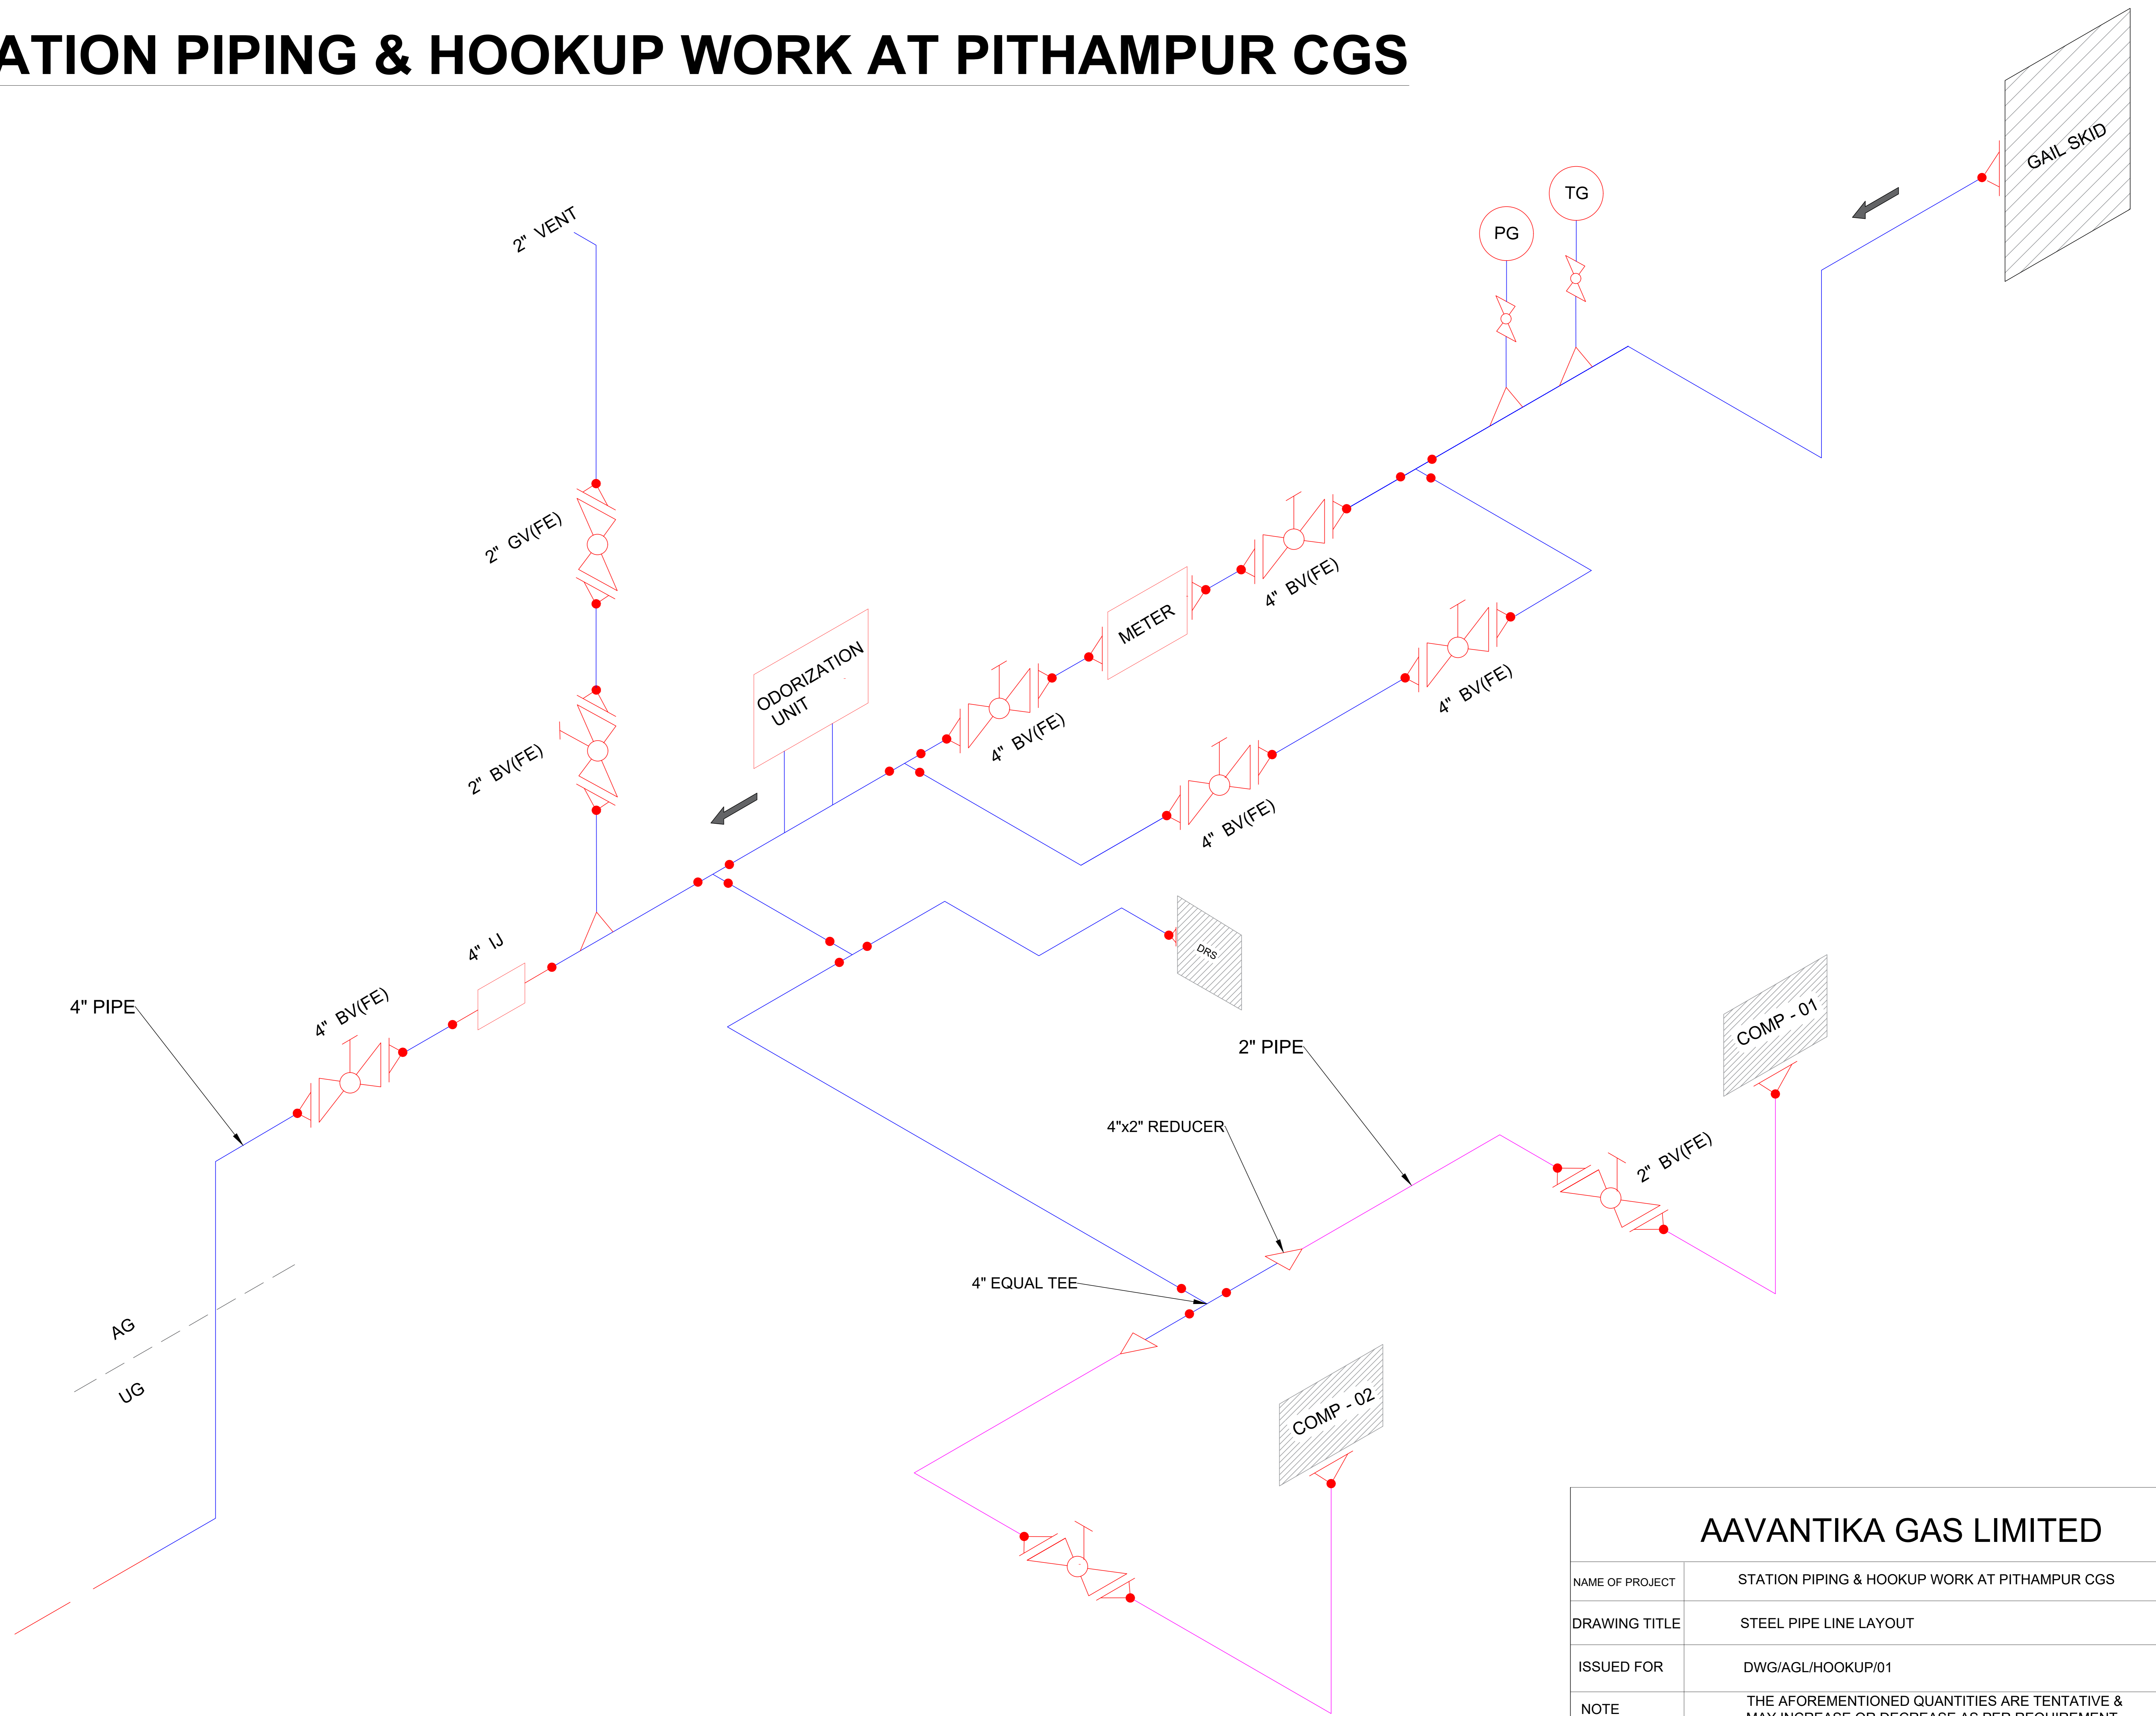

AAVANTIKA GAS LIMITED	
NAME OF PROJECT	STATION PIPING & HOOKUP WORK AT PITHAMPUR CGS
DRAWING TITLE	STEEL PIPE LINE LAYOUT
ISSUED FOR	DWG/AGL/HOOKUP/01
NOTE	THE AFOREMENTIONED QUANTITIES ARE TENTATIVE & MAY INCREASE OR DECREASE AS PER REQUIREMENT